

ARVIN-EDISON WATER STORAGE DISTRICT

REPORT OF DISTRICT OPERATIONS

January 2026



Backfilling the Blowout at Sycamore Spreading Works Row 6 Pond 4.

20401 East Bear Mountain Blvd.
Mailing: P.O. Box 175
Arvin, CA 93203-0175
Phone: 661-854-5573
Fax: 661-854-5213
E-mail: arvined@aebsd.org
Website: aebsd.org

WATER SUPPLY

Friant Division Central Valley Project (CVP)

- The current Friant Division Class 1 allocation is at 100%, which amounts to 40,000 AF. A late season Class 2 allocation of 10%, which amounts to 31,168 AF, was issued on December 31, 2025. On January 8, 2026, a 5% Class 2 Uncontrolled Season was issued, which made available an additional 15,584 AF.
- Exhibit “A” provides additional supply information for 2025 Water Year supplies.

San Joaquin River (SJR) Restoration Program (SJRRP)

- The final 2025 SJRRP allocation is 269,355 AF based on a 50% Exceedance forecast of 1,346,000 AF of natural river runoff, which is a Normal-Dry water year type.
- The final 2025 restoration schedule recommends the release of 185,000 AF of Restoration Flows to the river, which is less than the restoration allocation due to downstream capacity limitations, leaving approximately 80,000 AF of Unreleased Restoration Flows (URF).
- 40,000 AF of Tier 1 URFs priced at \$25/AF were made available to Friant Class 1 contractors, of which the District’s portion was 2,196 AF.
- 35,999 AF of Tier 2 URFs priced at \$169.54/AF were made available to Friant Class 1 contractors, of which the District’s portion was 8,006 AF.
- Thus far in WY 2025, Recapture and Recirculation supplies for the District are approximately 8,700 AF. Approximately 14,000 AF (total for all districts) may become available for the remainder of the year (February 2026).
- District’s Recovered Water Account (RWA) balance is approximately 27,000 AF. RWA credits allow the District to purchase water for \$10/AF during wet periods (uncontrolled season but subject to canal prorate) when RWA water is declared.

Other CVP Contractors

- The current North-of-Delta 2025 allocation is 100% for Agricultural Service Contractors.
- The current South-of-Delta 2025 allocation is 55% for Agricultural Service Contractors, this includes the District’s Fresno County supply which amounts to 1,650 AF. However, due to Delta water quality concerns and pumping limitations, it’s possible that not all the 1,650 AF will be made available to the District.

State Water Project (SWP)

- The initial California Department of Water Resources 2026 State Water Project allocation is 10%.

Kern River

- The Kern River 2025 April through July runoff is 82% of average.

Water Bank Facilities

- The District is expected to recover approximately 50,000 AF of previously banked supplies in Water Year 2025.

Metropolitan Water District (MWD) Program

- MWD account balance remains at 100,201 AF.
- The District obtained its sixteenth consecutive year approval from the State Water Resources Control Board regarding a Petition for a Consolidated Place-of-Use (CPOU) which now expires on July 22, 2026.
- The CPOU petition includes the ability to exchange all types of Arvin-Edison supplies with MWD including unbalanced exchanges.
- The District's 10-year NEPA documentation is complete and approved until March 2034.
- In January 2026, the District utilized the Water Quality Sub Account mechanism with MWD and delivered ~5,700 AF of Class 2 water that it expects to have returned in early 2026 Water Year.

Rosedale-Rio Bravo Water Storage District (RRBWSD) Program

- The District's account balance in RRBWSD on March 2025 was approximately 45,000 AF. District received 10,000 AF of returned bank supplies from RRBWSD in during Water Year 2025, leaving approximately 35,000 AF in the account balance.

District Partnerships

- The District received a ten-year approval (through Water Year 2035) from USBR to transfer and exchange Friant Division CVP water to Kings River Area Agencies and Kern County Districts.
- The District has participated in water management programs with the following districts/agencies in Water Year 2025 to date:

Fresno County
Madera Irrigation District
Del Puerto Water District
Wheeler Ridge-Maricopa WSD
Exeter Irrigation District
Westside Mutual Water Company

Rosedale Rio Bravo WSD
Kern-Tulare Water District
SJRRP Recapture/Recirculation
Chowchilla Water District
Lower Tule Irrigation District

WATER DEMAND

District turnout deliveries (not including on-farm recharge) for the month were 520 AF.

- The following is a summary of surface water deliveries for January 2026.

<u>Water Type</u>	<u>Month of January</u>		<u>Water Year to Date</u>	
	10 Yr. Avg.	2026	10 Yr. Avg.	2026
SWSA	1,162	493	115,301	114,416
In-Lieu		0		0
Temporary		27		27
Spreading*	n/a	22,812	n/a	25,128
	Total	23,332	Total	139,571

*Direct spreading, including Landowner (on-farm) Recharge

- Exhibits "B-1", "B-2", and "B-3" illustrate the delivery data.
- The month's peak daily in-District demand was 118 cfs, which occurred on the 28th.
- Exhibit "C-1" details Canal Water Quality information.
- Exhibit "C-2" presents the Aquatic Pest Control Treatments (\$0 for Calendar Year 2026).

GENERAL

- District vehicles consumed an estimated 4,370 gallons of fuel during the month (average fuel efficiency of 12.6 mpg).
- There were 316 hours lost due to illness and 32 hours lost due to on-the-job injuries.
- Exhibit "D" highlights precipitation, temperature, and wind speed.
- Exhibit "E" summarizes energy consumption and power demand.



Frank Lozano 30 Year Anniversary Recognition



Jerome Lyday 25 Year Anniversary Recognition


ENGINEERING DEPARTMENT ACTIVITIES

Routine Activities

- Review and accounting of District's water supply and related contracts.
- Administration or proposals of water management and wheeling agreements.
- Groundwater level surveys and associated exhibits.
- Water quality testing.
- ArcGIS database updates/maintenance (facilities, water service areas, boundaries, etc.).
- CIMIS station management (<https://cimis.water.ca.gov/Stations.aspx>).
- Land use/crop surveys with data entry.
- Monthly/annual reports regarding water deliveries, water use, and energy use.



Invasive Mussel Treatment Testing

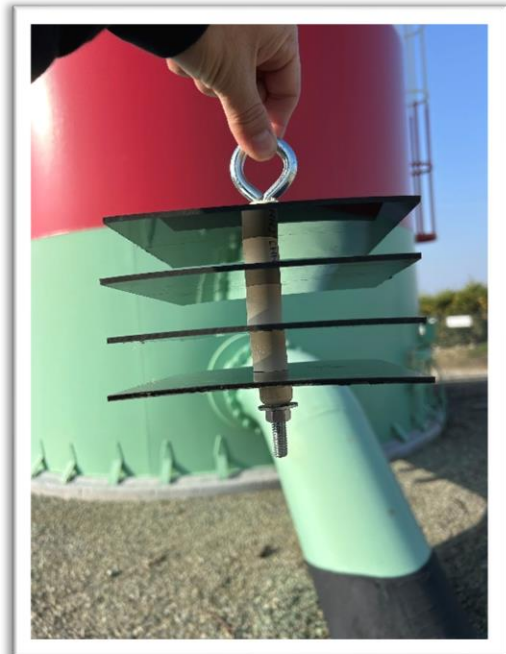

***Deploying Mussel Settling Plates
at Pump Plants for Monitoring***

Grants & Funding Opportunity Updates

Project Name	Drought Recovery Wells and Conjunctive Use Modeling Tool	Forrest Frick Unit Project		White Wolf Groundwater Sustainability Agency	Groundwater Flow Model and Decision Support Tool	North Canal Spreading Works Expansion Project		DiGiorgio Unit Phase 2b-5 Project
Grant Name	USBR 2023 WaterSMART Drought Recovery Program Grant	DWR Round 2 Integrated regional Water Management Grant	Community Project Funding Grant	DWR –SGM Round 2 Grant	USBR 2023 Water SMART Applied Science Grant	DWR – Flood Diversion Recharge Enhancement (FDRE) Grant	FY2026 Community Project Funding Grant	USBR 2024 Planning and Project Design Grant
Grant Type	Federal	State	Federal	State	Federal	State	Federal	Federal
Grant Status	Awarded	Awarded	Selected	Awarded	Awarded	Awarded	Secured	Awarded
Grant Amount	\$2 Million	\$2 Million	\$3.25 Million	\$4.8 Million	\$95,000	\$999,500	\$2 Million	\$308,170
Notes			<i>Pending grant agreement from EPA. Anticipated to receive in January 2026</i>		<i>Grant is complete</i>		<i>1/8/26 - Valadao press release issued for funding recipients 2/4/26 – Received official notification from EPA</i>	

- NRCS landowner incentive programs assist with implementing various conservation activities, including but not limited to, irrigation system improvements, filtration needs, water/nutrient/pest management, and engine replacement:
 - Phone (661) 336-0967
 - Website (www.ca.nrcs.usda.gov)
- North West Kern Resource Conservation District provides discounted on-farm irrigation distribution uniformity and efficiency testing
 - Phone (661) 281-2746
 - Website (<http://northwestkernrcd.org>)

AEWSD Current Construction Projects

	N24 & N26 Recovery Wells – Drilling & Equipping	N24 & N26 Recovery Wells – Electrical	S39 & T102 Wells – Drilling & Equipping	S39 & T102 Wells – Electrical
	Bakersfield Well & Pump	A-C Electric	Bakersfield Well & Pump	TBD
Construction Start Date	March 2025	March 2025	November 2025	TBD
Punch List	October 2025	September 2025	June 2026	TBD
Final Project Close-Out	February 2026	February 2026	June 2026	TBD
Current Construction Contract Costs	\$2,175,312 (Change Order #1-4 for revised quantities and additional days due to material delays)	\$551,596.37 (Change Order #1-3 for Fencing and additional days due to material delays)	\$2,229,092	TBD (Board Approved Amount \$525K)
Total Grant Funding	\$2,000,000 (Federal Share) \$2,160,421 (Recipient Share)		N/A	N/A
Notes	*Time Extension approved. Grant Funding needs to be spent by March 31, 2026			Electrical Construction pricing is being obtained.

	NCSW Expansion – FDRE – 1 st Contract	NCSW Expansion – FDRE - 2 nd Contract	White Wolf Subbasin 850 Canal Intertie	White Wolf Temp Water Program	Frick Unit Phase 2 – Main Line
	Pay Dirt Construction	Super Ag Construction	Laurel Ag & Water	Superior Ag Construction	Superior Ag Construction
Construction Start Date	July 2025	December 2025	July 2025	October 2025	February 2026
Punch List	November 2025	March 2026	February 2026	February 2026	October 2026
Final Project Close-Out	January 2026	March 2026	February 2026	February 2026	October 2026
Current Construction Contract Costs	\$1,048,815.25 (Change Order #1-5 approved to add raising of exterior levees work, no cost time extension and rip rap)	\$742,953.77 (Change Order #1 approved 12/3/25 to extend completion date due to raising of exterior levees work)	\$646,794.49 (Change Order #1-2 approved for extra work and weather delays. Change order #3 for no cost time extension due to weather and material delays)	\$781,305.65 (Change Order #1 approved for extra work. Change order #2 for no cost time extension due to weather and material delays)	\$4,354,795.08
Total Grant Funding	\$999,500		\$925,000	\$1,345,000 (\$212,000 is allocated to WRMWSD)	\$1,000,000 (DWR Estimated Remaining Funds after Phase 1)
Notes	*FDRE Grant Funding needs to be spent by March 31, 2026		*Grant Amendment for No Cost Time Extension was submitted on 1/13/2026 to extend out to 6/30/2026	*Grant Amendment for No Cost Time Extension was submitted on 1/13/2026 to extend out to 6/30/2026	EPA Funding will be used for Phase 3 – Laterals DWR Funding to be spent by March 2027.

AEWSD Upcoming Construction Projects

	Frick Unit Phase 3 - Laterals
Bid Advertisement	April 2026
Board Approval	May 12, 2026
Anticipated Notice to Proceed	May 2026
Mobilization Start	June 2026
Projected Completion Date	October 2026
Current Estimated Costs	\$4,195,000
Total Grant Funding	\$3,250,000 (EPA Grant Funding will be allocated to both Phase 3 of the Project)
Total AEWSD Funding for Projects	\$7,939,000
Notes	<p><i>*Schedule tentative to change - pending EPA grant agreement</i></p> <p><i>*DWR Grant Funds must be spent by March 31, 2027</i></p>

Other Activities

- Administration and accounting of on-going water management programs.
- Technical support and review of ongoing projects/studies such as:
 - Potential Interconnections with other Districts.
 - Pump Replacement Program.
 - Turnout Modification Requests.
 - Temporary and/or In-Lieu Water Service Contract Requests.
 - Pump Efficiency Testing.
 - Real Time Water Quality Monitoring.
 - Stand tank Painting Project.
 - Stand tank and pressure vessel inspections.

SGMA Activities

- The Kern Subbasin continuation hearing was held September 17, 2025. The State Water Resources Control (SWRCB) board was satisfied with the 2025 GSP and decided to send the Subbasin back to the California Department of Water Resources. The official letter from the SWRCB sending the Subbasin back to the DWR was issued December 8, 2025.
- The Kern Subbasin 2025 GSP is now being implemented.
- Continued coordination meetings and outreach activities.
- Attended various GSA meetings.

- Collected groundwater levels and water quality data.
- Continued coordination efforts with South of Kern River GSAs (posted on website www.sokrgsp.com).
- Continued implementation and coordination efforts with White Wolf Subbasin GSA and GSP (posted on website www.whitewolfgsa.org).

Requests for Information/Easements/Planning Notices

- Water supply
- Water costs
- Historical groundwater levels
- Monitoring well conversions
- Water quality
- Land use data
- Easements and/or right-of-way encroachments
- Reviewed/responded to multiple planning notices
- Reviewed/responded to environmental documents as necessary
- Responded to As Built Requests

Power Related Activities

- Revised power purchase agreements with White Pine Renewables for a total of 10 MW solar production.
- Managed Electrical Distribution Expansion Study process.
- Reviewed Renewable Portfolio Standards balances.
- Coordinated planned PG&E outages, meter repairs and reviewed Trimark and RBI invoices.
- Performed weekly load forecast reviews.
- Reported on PWRPA power accounting.
- Reviewed PWRPA monthly invoices for billing anomalies/meter reconciliations.
- Reviewed power reconciliation reporting tool.
- Worked on On-Farm Solar RECS agreements and reporting.
- Maintained Wells First Off List (efficiency rating).
- Performed Load forecast updates and rate analysis.
- Coordinated with PG&E on meter inventory information.
- Coordinated new power service design and construction projects.
- Coordinated monthly landowner Groundwater meter reads, repairs and prepared reports.

SPREADING WORKS OPERATIONS (WELLFIELDS AND BASINS)

- Exhibit “F” summarizes wellfield production to date.
- Exhibit “G-1” summarizes gross direct spreading to date.
- Exhibits “H-1” and “H-2” summarize current static and/or pumping water in table and graphic forms.

Arvin-Edision Water Storage District
 Well Field Management
Well Repair Status Report

121525001-WELL

February 04, 2026

Well Number	Year Built	Age (Years)	Cased Depth (ft)	Previous Well Condition Rating	Current Status	Problem	Notes/Discussion
Sycamore 13	1967	59	840	Acceptable	Permanently Out of Service	Apparent Pump Failure	<ul style="list-style-type: none"> o Well needs to be abandoned in some manner after pump was not able to pulled from well. o The pump would not come free and the column/tube/shaft ultimately separated 220' down. o I recommend we install a locking cap on the well head and leave it as is.
Tejon 84	1970	56	996	Acceptable	Out of Service	Pump Failure	<ul style="list-style-type: none"> o Pump Re-Development and a Pump Test were performed in January (by BWP) o Results were excellent. Good production and sand down to a trace. o BWP will install a new pump in the well. o Well is expected to be returned to service in February or March.

OPERATIONS DEPARTMENT ACTIVITIES

Routine Activities

- Operated District's water distribution and delivery systems (canal, reservoirs and wells).
- Conducted monthly safety meetings.
- Performed monthly meter reads at Turnouts and Pump Plants (water and power).
- Maintained weed control at Pump Plants, Turnouts, Air-Vents, and Isolation Valves.
- Monitored Forrest Frick Pumping Plant operations and Intake Canal water levels.
- Inspected control systems at Pump Plants (Transducers, Cla-valves, etc.).
- Replaced burned out Pump Plant lights and panel bulbs.
- Monitored flows and levels at the Intake, North and South Canal.
- Applied warning labels on Turnouts.
- Took daily spreading basin readings.



Installing a Valve at S32-P1.

Additional Activities

- Replaced SGMA well meter batteries.
- Replaced locks and chains on various Intake gates.
- Continued fine tuning and upgrading WildEye remote monitoring of Turnout meters.
- Charged WildEye external batteries District wide.
- Coordinated multiple shutdowns for District wide projects.
- Oversaw spreading and farmer recharge programs.
- Installed WildEye on the North spreading gravity meter.
- Held a Landowner workshop for Latis and WildEye.
- Installed a bypass valve on Pump Plant S32-P1.
- Re-programmed Turnout C-98 meter and North gravity meter.
- Replaced Turnout C-67 meter and re-programmed WildEye.



Latis and WildEye Landowner Workshop Presentation Held at Headquarters.

Underground Service Alert (USA) Report

- District initiated 1.
- Responded to 284 USA notices to locate District underground facilities.
 - o 26 required markings of District facilities.
 - o 111 were renewals.
 - o 147 with no conflicts.

Power Outages and/or Interruptions Involving the Following Systems

Power Interruptions													
FFPP		BR		S32		S68		S88		OFFICE		SYC	
N1	1	N41		S38		S73		S93		INTERTIE		TEJON	
N8		N55		S64		S78		EOC		NC		CVC	

Lateral Prorates

Prorated Laterals (days)											
N1	0	N8	0	N24	0	N41	0	N55		0	
S32	0	S38	0	S64	0	S73	0	S88	0	S93	0

Facility Improvements (Repairs-R or New-N)

Meters-N				Valves -N			
C-67							


MAINTENANCE DEPARTMENT ACTIVITIES

Routine Activities


- Performed weekly yard duties at Headquarters.
- Cleared-out forebays at North and South Canal.
- Organized Maintenance Warehouse.
- Maintenance of the CIMIS Station.

Additional Activities

- Prepared North Canal Spreading Works for Spreading.
- Cleaned up tumbleweeds at all Spreading Basins.
- Secured new chain-link fence line at Turnout NC-B.
- Replaced 100' of stolen chain link fence at Balos Rd dump site.
- Installed new lockout chain at Turnouts C-109 & C-62.
- Repaired pinhole leak at Turnouts C-109 & C-95.
- Placed riprap at the North Canal Spreading Works Expansion.
- Repaired a broken 90-degree elbow for an ARV at Lateral S73-B.
- Backfilled 2" crush rock for the bridge at North Canal Spreading Works.
- Backfilled washouts at the 10-ac spreading facility.
- Built and installed Mussel settling plates at Pump Plant N55-P7.

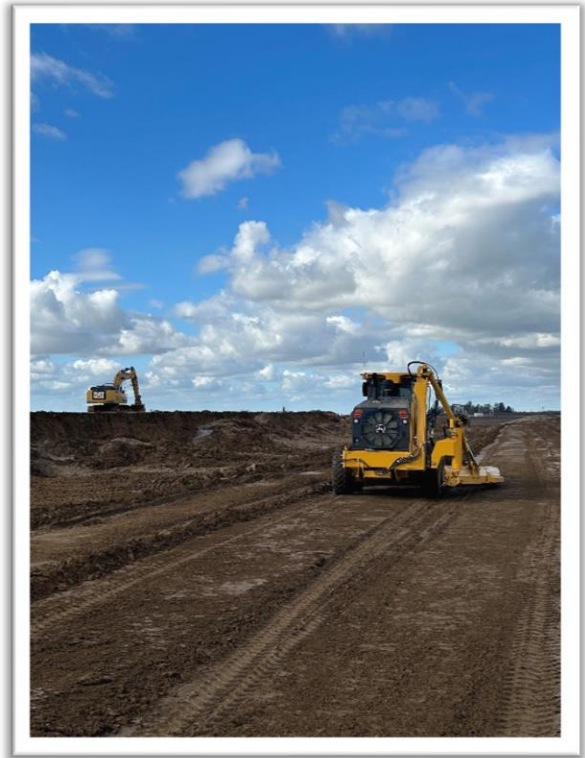

Grading and Dirt Work at Sunset Spreading Works

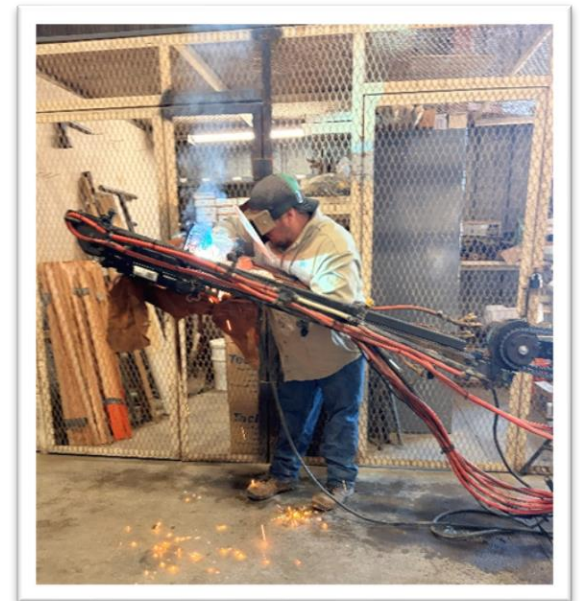


Welding a Bracket on the Boom Arm for the Spray Truck


Mechanic's Shop Repair Activities

- Performed weekly inspection on the Fuel Tank and Gas Pump.
- Repaired the Trail King trailer light.
- Fixed air compressor on vehicle 367.
- Fixed an air leak on the dump truck.
- Installed a new battery on the Kabota.

Part	Repair/Replaced	Part	Repair/Replaced
Routine Service	15	A/C Service/Heater	2
Brakes	2	Belts	1
Tires	8	Headlights/Taillights	0/2
Tire Repairs	3	Shocks	0
Rotors/Drums /Wheel Bearings	2/0	Wiper Blades/Engine Washes	8/0
Batteries	2	Cabin Filter	2
Fuel Filters	4	Trailer Lights/Spotlights	2/0
Tune-ups	0	Cleaned Throttle Body	2
Clean TPS Sensor	2	Misc	2

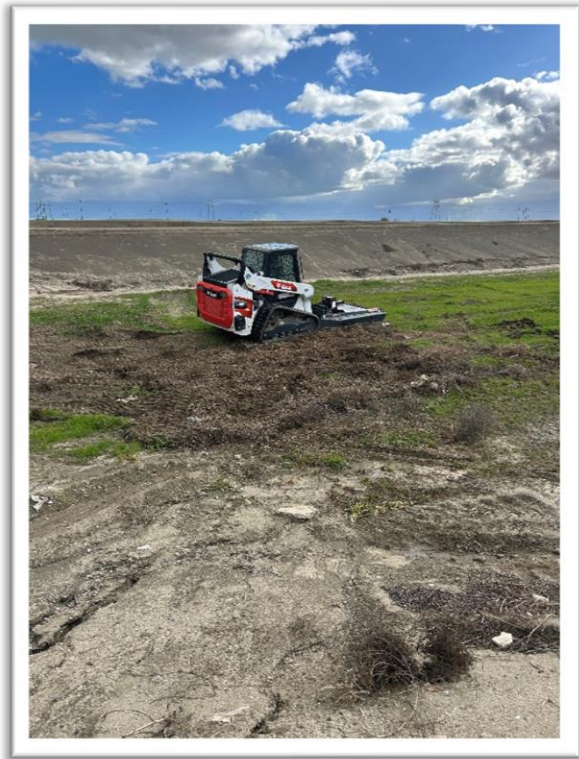

Backfilled the Washouts at North Canal Spreading Works

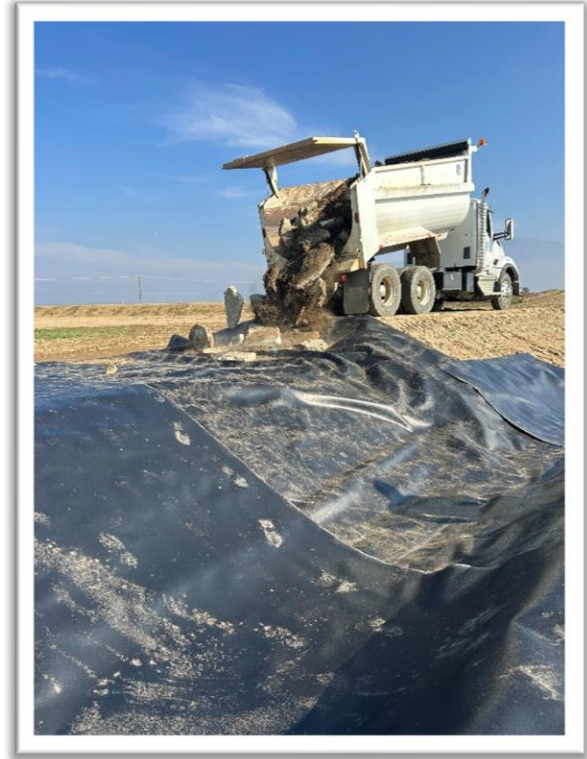

Rip-rapped at North Canal Spreading Works Spreading Structure


PUMP DEPARTMENT ACTIVITIES

Routine Pump Maintenance Activities


- Replaced various pump packings.
- Lubricated pump bearings at various Pumping Plants.
- Maintained drip oil on District Wells.
- Inspected and maintained Air Compressors.
- Inspected and/or adjusted Traveling Water Screens/Moss Screens.

Additional Activities

- Prepared for spreading by exercising valves and weirs.
- Inspected the Intertie pumps at Howard Frick Pump Plants.
- Replaced all the couplers for the pumps drain lines District-wide.
- Replaced the rollers on the Moss Screen at Pump Plant S64-P1.
- Installed a new compressor pump at Pump Plant N1-P1 unit #1.
- Repaired the compressor pump unit #2 at Tejon Spreading Works.
- Repaired the shafts for the Moss Screen at Pump Plants N1-P1, N8-P1, N55-P1, and S38-P1.
- Removed debris from Twins Moss Screens and impellers and hauled them off location.
- Replaced a bad foot check valve for the Moss Screen sprayer pump at the End of the Canal.
- Assisted the Controls Department with installing a valve at Pump Plant S32-P1.
- Installed a new 1" air valve at N8-P1 unit #4.
- Replaced a damaged 1" ball valve at Pump Plant S73-P1 unit #5.
- Replaced a broken roll pin on a 16" check valve at Pump Plant S64-P2 unit #4.

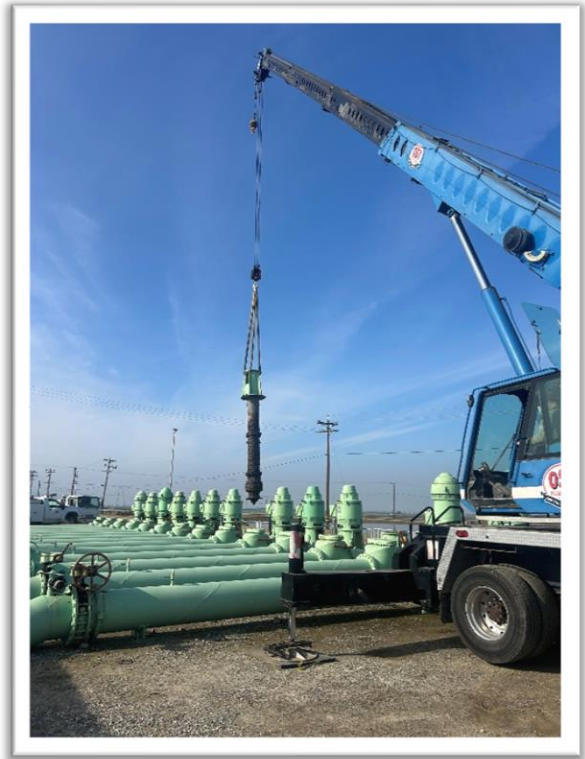

Removed a Vertical Pump at Tejon Upstream Pump Unit #7

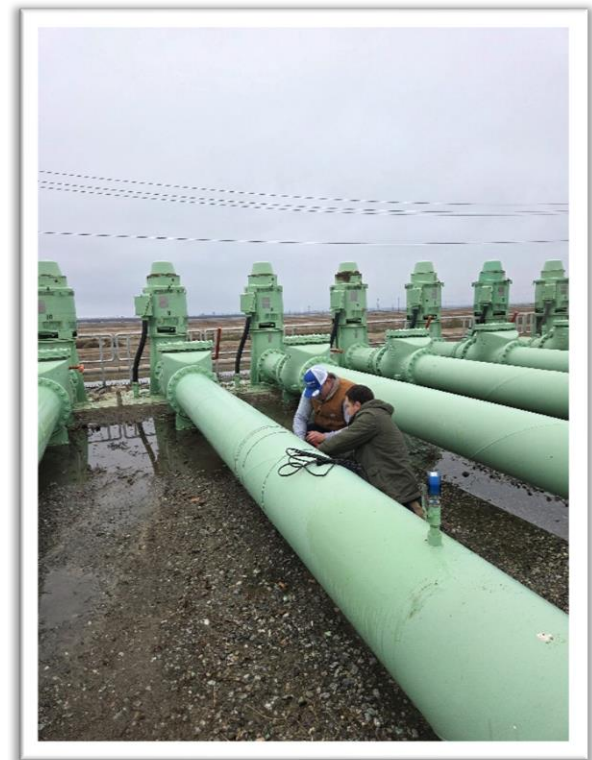

Performed Pump Tests on Unit#10 At Tejon Spreading Works

- Removed a 20 CFS vertical pump from Tejon Spreading upstream pumps unit #7.
- Assisted the Controls Department in troubleshooting the Tejon Check Gate 461 and put it back into operation after repairs.
- Installed and repaired a 200 HP vertical motor at Tejon Spreading Works upstream pump unit #3.

PUMP & MOTOR REPAIR SUMMARY

	Pumping Plant/Wells	Unit	Size	Time/Hours	Reason
Vertical Pumps	Tejon Spreading	7	20 CFS	N/A	Not Efficient
Vertical Motors					
	Tejon Spreading	3	200 HP	01882.5	Bad Motor Leads
Horizontal Pumps					
Horizontal Motors					

CONTROLS DEPARTMENT ACTIVITIES

Routine Activities

- Processed monthly purchase orders.
- Performed electrical maintenance and repairs.
- Monthly inventory.

Distribution System Improvements (Repairs-R or New-N)							
Starter Controls	Contactors / Soft Start	Aux. Contact Block	Motor Control Panels	Battery Back-up Units	Circuit Breakers	Hour meters	Trip Units
	R – S64-P1 unit #3 – reset & cleared fault & alarms	N – S88-P1 unit #1 – installed H-O-A normally open contact block					
	R – S64-P1 unit #4 – reset & cleared fault & alarms						

Distribution System Improvements (Repairs-R or New-N)							
Radios	PLC's or Control Modifs.	Photocell / Lights	Wiring	Valve Controllers or Limitorque	Coils	Relays / Thermal I O/L	Fuses / Transducer s
			R – Tejon Checkgate – replaced burnt control wiring	N – S32-P1 – installed new Worcester automatic valve actuator		N – N41-P1 unit #1 – replaced machine tool relay	R – S32-P1 – installed pressure transducer
			N – S73-P4 – installed volmeter monitor	N – Wasteway – replaced pressure regulator			

Well Facility Improvements (Repairs-R or New-N)							
Transformers (number)	Thermal Overloads	Lightning Arrestor	Panel wiring / Circuit Breaker /Cont	Soft Start Equip- ment	Control Fuses	Relays / Switches	12KV Fuses

Additional Activities

- Forrest Frick Pumping Plant units #1 and #6 had an alarm on the DC exciter monitor indicating blown fuse. Replaced 3 bad fuses.
- Forrest Frick Pumping Plant unit #4 had an alarm on the power management relay. Troubleshoot and found a blown fuse inside the relay control circuit. Replaced the relay control circuit.
- Inspected and cleaned all the unit's motor carbon brushes.
- Constructed metal pole support and installed a new telemetry control enclosure for the plc and control circuit at Pump Plants N1-S5 and S93-S3.
- Worked with contractor at the Wasteway to re-program the automatic condensation drain solenoid valve, inflate/deflate of the gate bladder compressor, and shut-off control of the Wasteway gate bladder and compressor on master Scada.
- Upgraded both master and redundant desktop computers of the master Scada software to 8.3 version with contractor.
- Updated the program on the SD card of the AB plc of each District Pump Plant.
- Installed voltage and current display monitor meter at Pump Plants N55-P6, S32-P1, S38-P1, S38-P2, S64-P3, S73-P1 and S73-P4 with contractor.

FORREST FRICK PUMPING PLANT

- 29,614 AF of water was pumped during the month.


HOWARD FRICK PUMPING PLANT (AQUEDUCT INTERTIE)

- 0 AF was delivered to the District from the CA Aqueduct through the Howard Frick Pumping Plant/Pipeline and 5,798 AF was returned.

EXHIBIT "A-1"
ARVIN-EDISON WATER STORAGE DISTRICT
2025 WATER SUPPLY AND DEMAND

<u>SUPPLY</u>	<u>AF</u>	<u>%</u>
FRIANT-KERN (F-K)		
40,000 AF CLASS 1 (100%)	40,000	
311,675 AF CLASS 2 (9.3% CLASS 2)	28,832	
Uncontrolled Season (5.0% CLASS 2)	15,584	
URF TIER 1 BLOCK A (0.2% CLASS 2)	554	
URF TIER 1 BLOCK B (0.5% CLASS 2)	1,642	
URF TIER 2 BLOCK AA (0.9% CLASS 2)	2,669	
URF TIER 2 BLOCK BB (1.0% CLASS 2)	3,224	
URF TIER 2 BLOCK CC (0.7% CLASS 2)	2,113	
PRIORITY URF (1.8% CLASS 2)	5,521	
WATER QUALITY MITIGATION (KERN TULARE)	577	
CARRYOVER OF 2024 WATER	<u>2,018</u>	
SUBTOTAL	102,734	
CHOWCHILLA WSD EXCHANGE (URF/CLASS 1)	1,085	
MADERA IRRIGATION DISTRICT	-5,950	
WESTSIDE MUTUAL WATER COMPANY	-5,000	
CITY OF BAKERSFIELD (EXCHANGE)	-4,995	
PIXLEY IRRIGATION DISTRICT (RETURN TO PACIFIC RES.)	-4,440	
KERN TULARE EXCHANGE	-2,800	
LOWER TULE ID & PIXLEY ID	-2,640	
CHOWCHILLA WSD EXCHANGE (RECAP/CLASS 1)	-1,800	
CHOWCHILLA WSD EXCHANGE (URF/CLASS 1)	-1,085	
SHAFTER-WASCO ID (RETURN TO PACIFIC RES.)	-560	
FRESNO COUNTY	-511	
KERN TULARE (WATER QUALITY MITIGATION)	<u>-500</u>	
SUBTOTAL	-29,196	
TOTAL F-K	<u>73,538</u>	46.4%
GROSS VALLEY CANAL (CVC)		
ROSEDALE WSD	10,000	
SJRPP RECAPTURE RECIRCULATION	12,250	
KERN TULARE/ ID4 EXCHANGE	2,800	
CHOWCHILLA WSD EXCHANGE (RECAP/CLASS 1)	2,160	
FRESNO COUNTY (55% CVP)	416	
WHEELER RIDGE WSD	1,205	
EXETER IRRIGATION DISTRICT	271	
DEL PUERTO WATER STORAGE DISTRICT	-3,209	
DROUGHT POOL PROGRAM	-361	
SLR 1% EVAPORATION & LOSSES	<u>-278</u>	
TOTAL CVC	25,254	15.9%
INTERTIE PIPELINE (IPL)		
WHEELER RIDGE WSD	<u>8,811</u>	
TOTAL IPL	8,811	5.6%
TOTAL IMPORT	107,603	67.9%
GROUNDWATER PUMPING		
IRRIGATION DEMAND	<u>50,899</u>	
TOTAL PUMPING	50,899	32.1%
<u>TOTAL WATER SUPPLY</u>	<u>158,502</u>	100.0%
DEMAND		
IRRIGATION DEMAND (MARCH-JANUARY '26)	114,389	72.2%
IRRIGATION DEMAND (FEBRUARY '26)	4,610	2.9%
SPREADING (MARCH-JANUARY '26)	25,155	15.9%
SPREADING (FEBRUARY '26)	0	0.0%
METROPOLITAN WD - WATER QUALITY SUB-ACCOUNT	5,722	3.6%
CARRYOVER TO 2025	4,000	2.5%
LOSSES/METERING INACCURACIES	<u>4,626</u>	<u>2.9%</u>
<u>TOTAL DEMAND</u>	<u>158,502</u>	100.0%

Exhibit "A-2"
 ARVIN-EDISON WATER STORAGE DISTRICT
2025 WATER MANAGEMENT

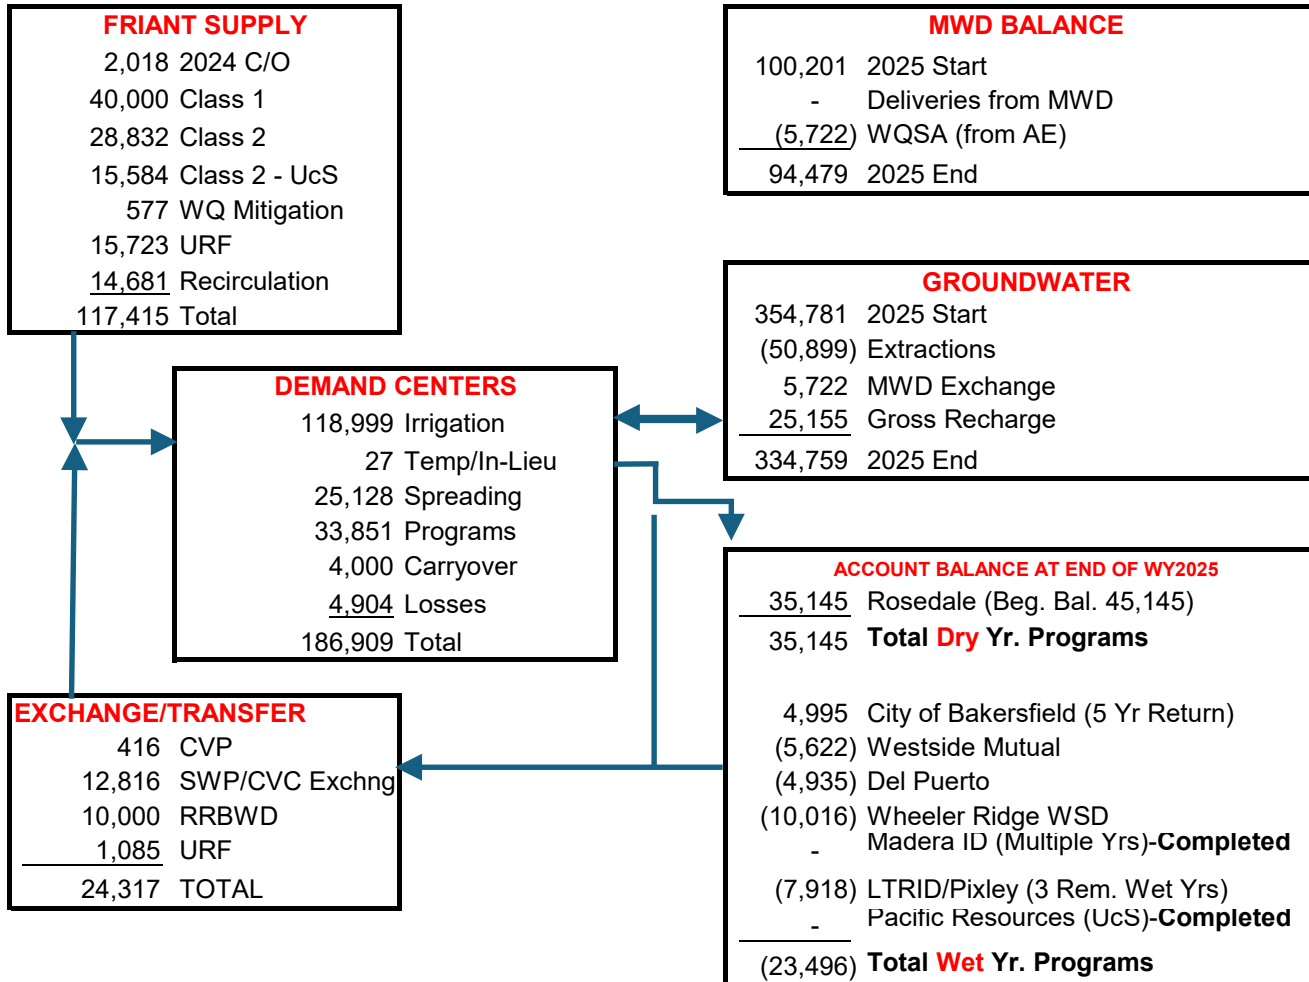

Surface Water	68,127	57%
Groundwater (32% of Max)	50,899	43%
Projected Irrigation Demand	119,026	100%

EXHIBIT B-1 ARVIN-EDISON WATER STORAGE DISTRICT 2025 WATER YEAR DELIVERIES BY UNIT

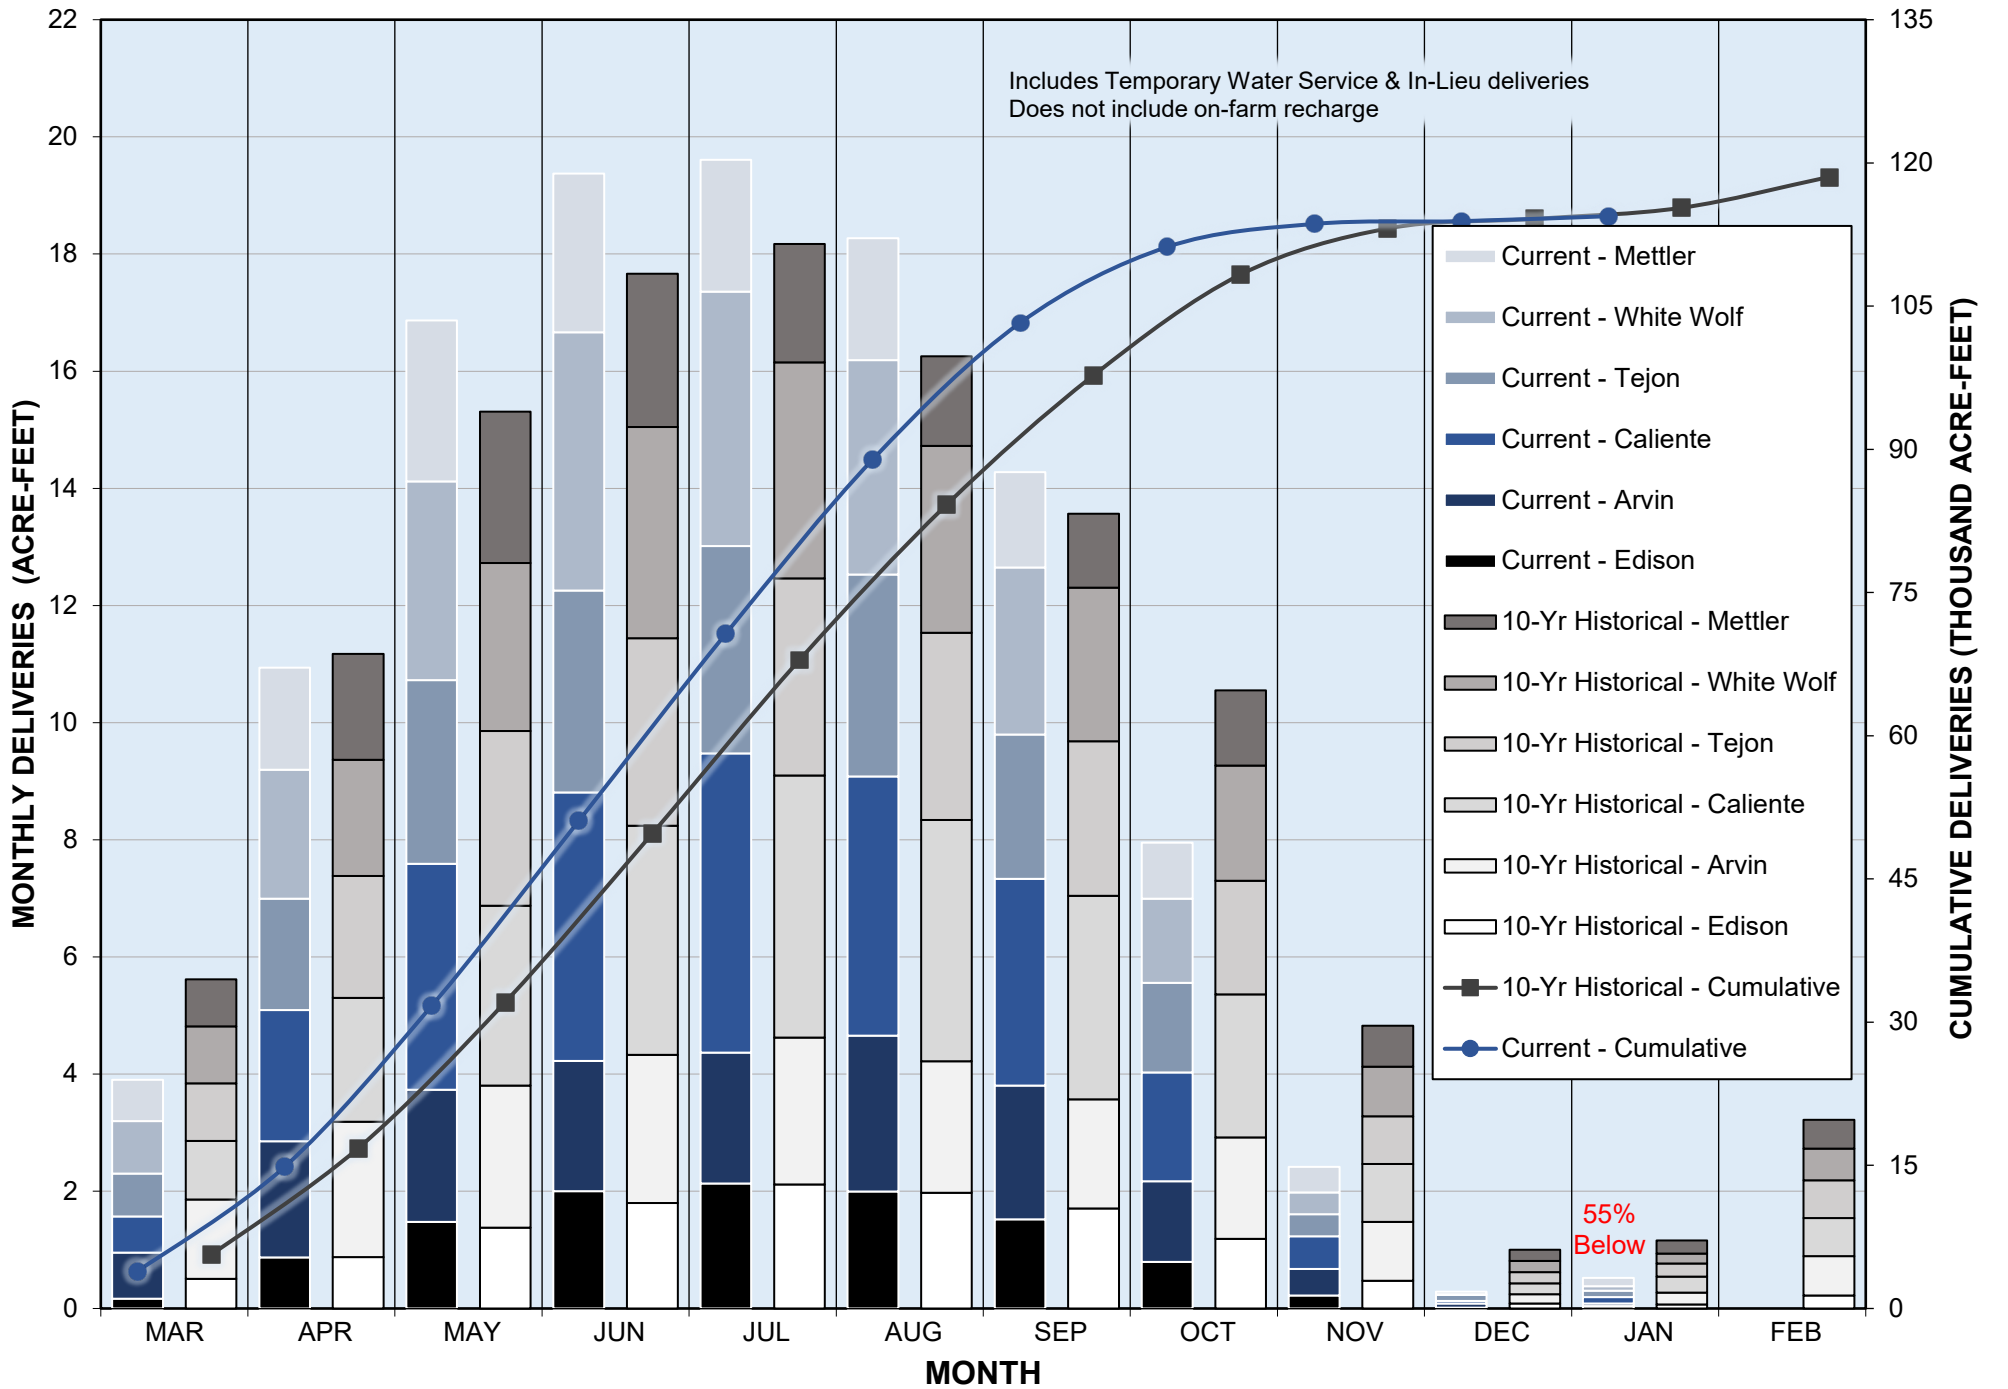


EXHIBIT B-2 ARVIN-EDISON WATER STORAGE DISTRICT HISTORIC JANUARY DELIVERIES BY YEAR

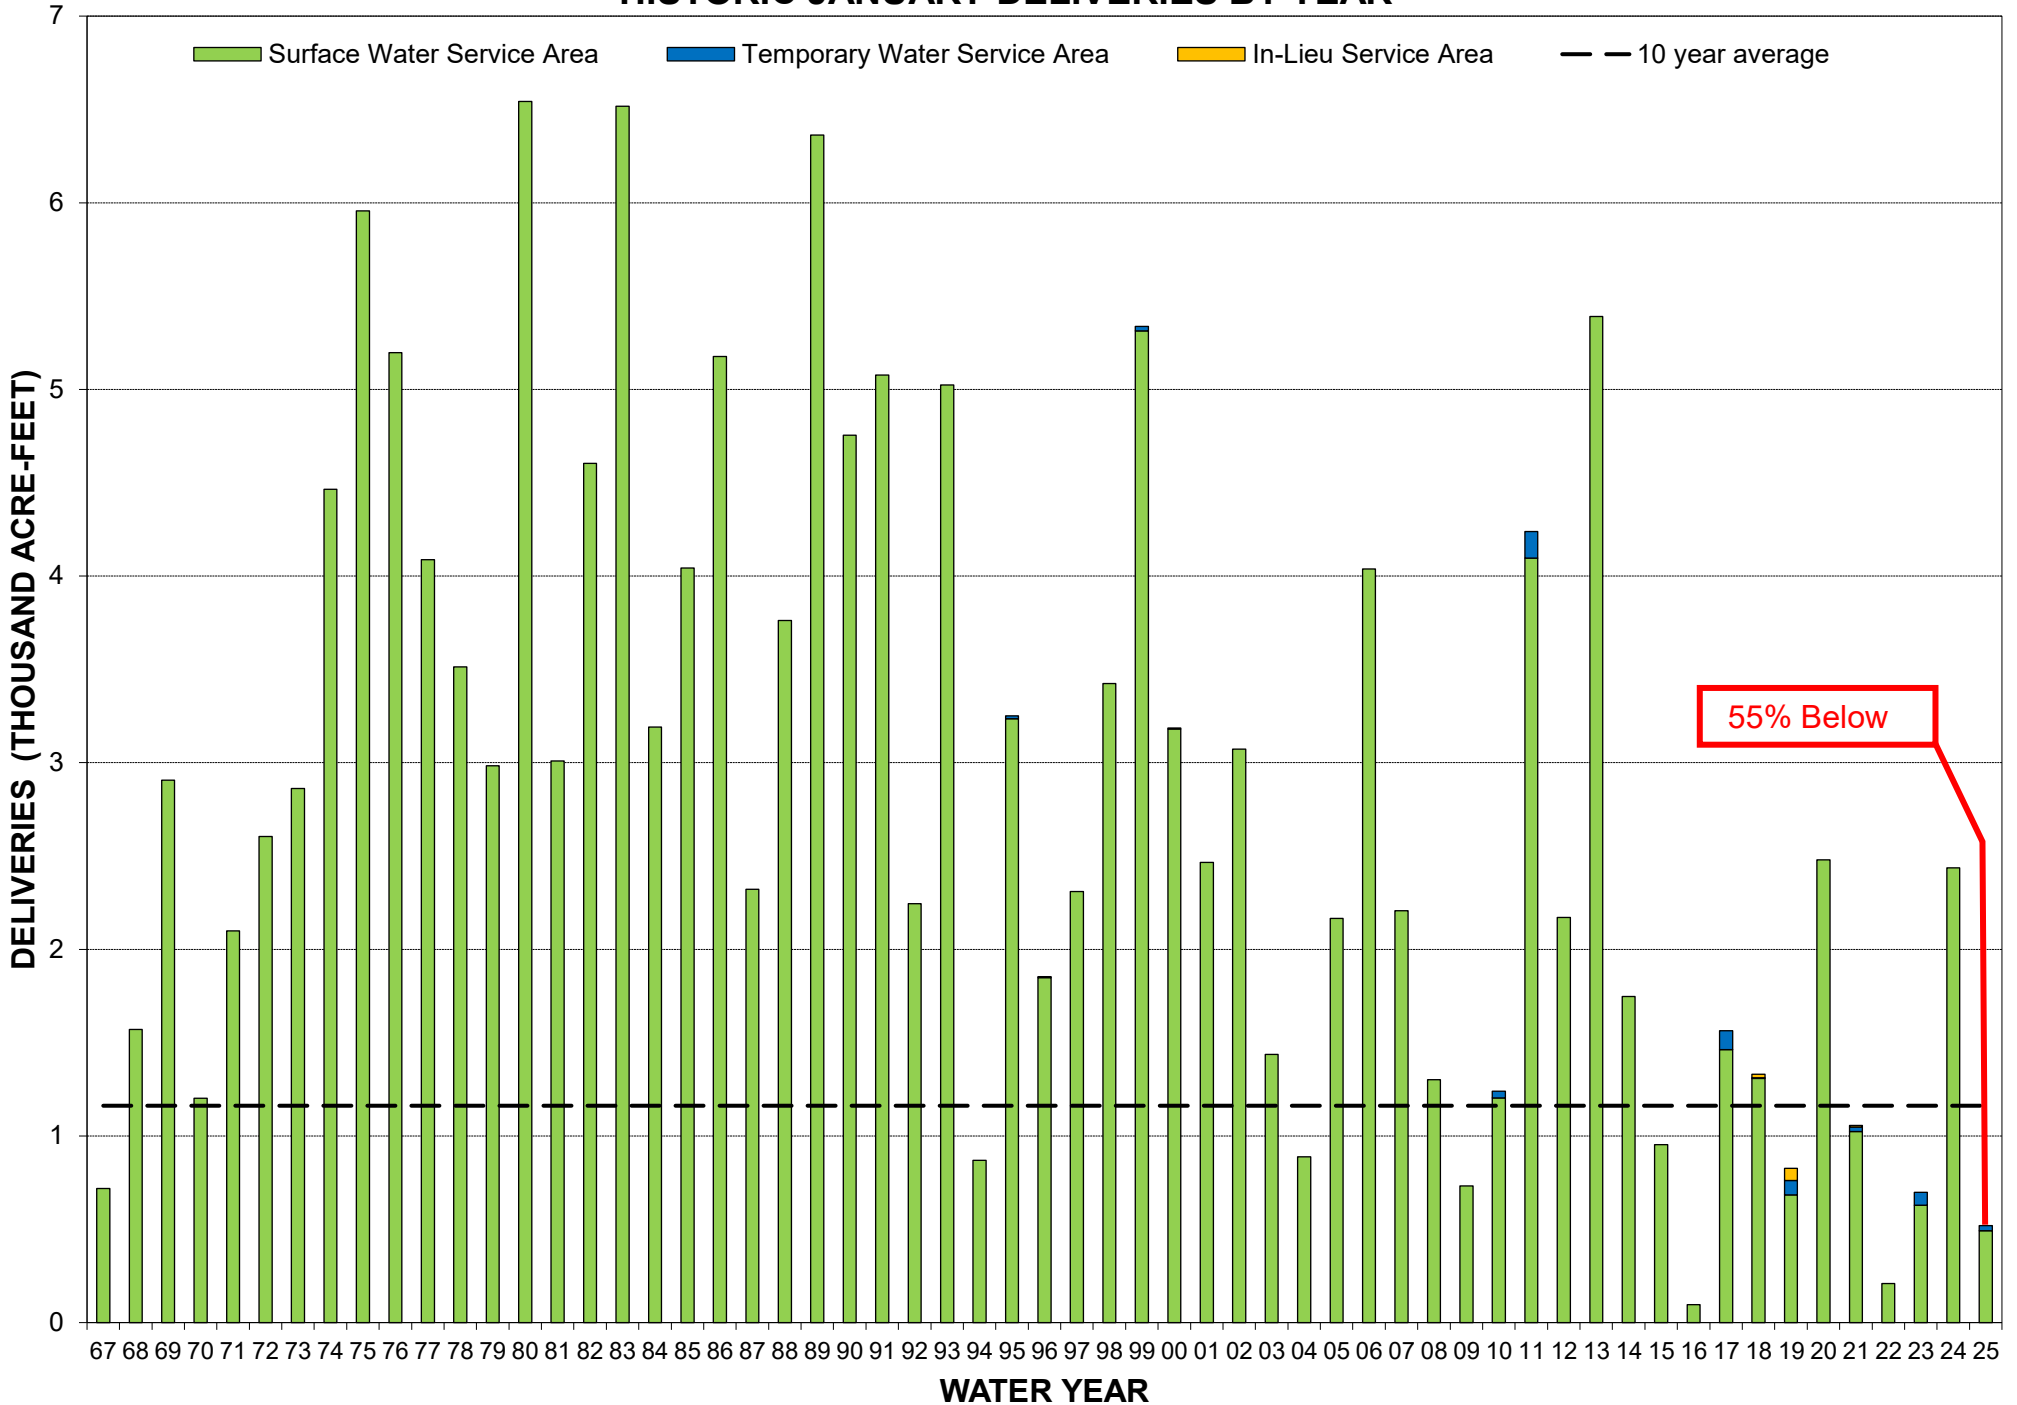


EXHIBIT B-3
ARVIN-EDISON WATER STORAGE DISTRICT
HISTORIC JANUARY DELIVERIES BY MAGNITUDE

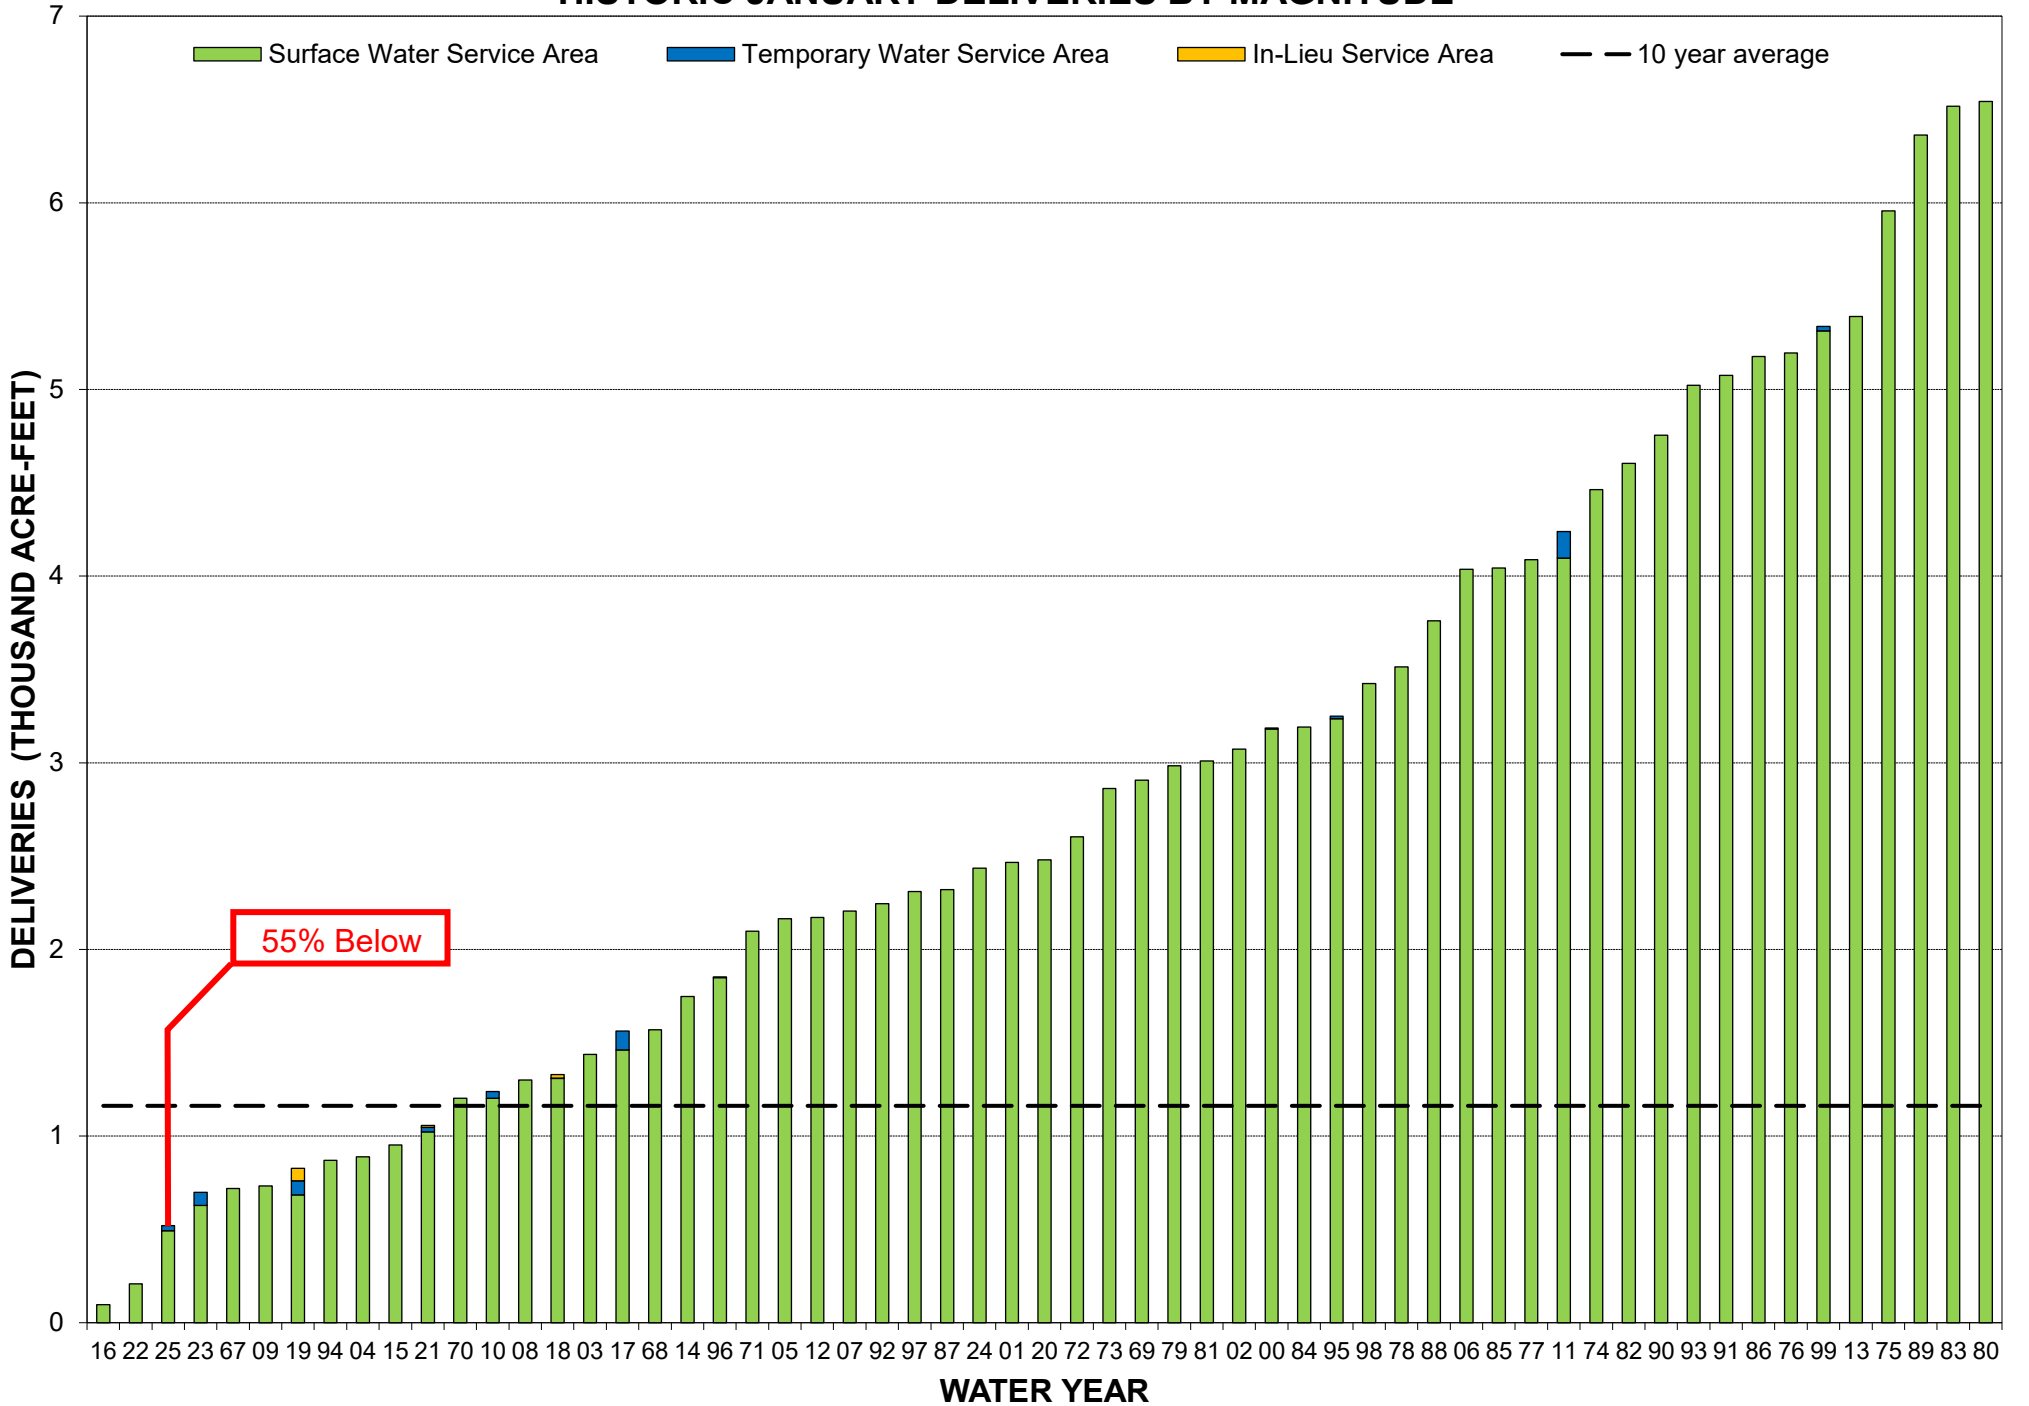


EXHIBIT "C1"
ARVIN-EDISON WATER STORAGE DISTRICT
WATER SUPPLY WATER QUALITY SUMMARY

	Date	Flow cfs	Import Source	Calcium		Magnesium		Sodium		Bicarbonate		Chloride		Nitrate		TDS	pH	EC umhos/cm	Hardness mg/l	SAR	Gypsum lbs/AF	Boron mg/l	Turbidity NTU
				mg/l	me/l	mg/l	me/l	mg/l	me/l	mg/l	me/l	mg/l	me/l	mg/l	me/l								
Intake Canal	01/06/26	350	FKC (100%)	4.0	0.2	0.8	0.1	3.3	0.1	14	0.2	1.8	0.1	ND	ND	34	6.8	43	13	0.2	0.0	ND	39.0
	12/08/25	0	DOWN FOR MAINTENANCE/RESIDUAL	20.0	1.0	14.0	1.1	82.0	3.5	73	1.2	130.0	3.7	ND	ND	340	7.7	650	110	3.1	0.3	ND	4.7
	11/13/25	0	WELLS(100%)	14.0	0.7	4.0	0.3	22.0	0.9	58	1.0	17.0	0.5	ND	ND	130	7.9	200	51	1.0	0.1	100.00	9.1
	10/02/25	125	FKC (100%)	16.0	0.8	12.0	1.0	55.0	2.4	81	1.3	88.0	2.5	ND	ND	230	8.0	460	92	2.3	0.2	ND	2.6
	09/11/25	125	FKC (60%)/CVC (40%)	14.0	0.7	8.9	0.7	32.0	1.4	67	1.1	49.0	1.4	ND	ND	170	7.7	290	71	6.4	0.2	ND	3.4
	08/05/25	226	FKC (55%)/CVC (45%)	13.0	0.7	7.7	0.6	26.0	1.1	58	1.0	31.0	0.9	ND	ND	160	7.6	240	64	6.4	0.1	ND	4.6
	07/09/25	251	FKC (60%)/CVC (40%)	20.0	1.0	12.0	1.0	45.0	1.9	64	1.0	57.0	1.6	ND	ND	240	8.6	410	99	4.0	N/A	110.00	4.5
	06/17/25	201	FKC (50%)/CVC (50%)	17.0	0.9	9.9	0.8	33.0	1.4	70	1.1	41.0	1.2	ND	ND	190	8.1	340	84	5.0	0.1	110.00	5.1
	05/01/25	100	FKC (100%)	10.0	0.5	5.0	0.4	18.0	0.8	45.0	0.7	22.0	0.6	ND	ND	120.0	7.9	190.0	46.0	7.0	0.1	ND	6.6
	04/10/25	300	FKC (100%)	4.3	0.2	0.8	0.1	4.2	0.2	20.0	0.3	2.8	0.1	ND	ND	53.0	6.9	51.0	14.0	4.0	0.1	ND	28.2
	03/04/25	0	WELLS(100%)	19.0	1.0	9.6	0.8	34.0	1.5	58.0	1.0	38.0	1.1	ND	ND	290.0	9.2	340.0	88.0	4.4	0.1	110.0	13.0
	02/11/25	70	CVC (100%)	21.0	1.1	12.0	1.0	46.0	2.0	75.0	1.2	55.0	1.5	1.4	0.02	220.0	8.5	420.0	100.0	3.6	0.2	170.0	6.0
	01/07/25	0	RESIDUAL/DEWATERED	21.0	1.1	10.0	0.8	50.0	2.2	110.0	1.8	57.0	1.6	3.4	0.05	220.0	8.3	430.0	97.0	2.7	0.2	160.0	14.4
12/11/24	25	CVC (100%)	18.0	0.9	9.0	0.7	37.0	1.6	110.0	1.8	49.0	1.4	1.1	0.02	190.0	7.3	350.0	81.0	4.1	0.2	100.0	22.0	
Average				15.1	0.8	8.3	0.7	34.8	1.5	64.5	1.1	45.6	1.3	2.0	0.0	184.8	7.9	315.3	72.1	3.9	0.1	122.9	11.7
North Canal	01/06/26	82	FKC (100%)	5.3	0.3	0.7	0.1	2.8	0.1	22.0	0.4	1.6	0.0	ND	ND	35.0	7.9	47.0	16.0	0.2	0.0	ND	30.0
	12/08/25	0	DOWN FOR MAINTENANCE/RESIDUAL	31.0	1.6	6.0	0.5	68.0	2.9	130.0	2.1	37.0	1.0	12.0	0.2	330.0	8.1	520.0	100.0	3.0	0.4	660.0	5.1
	11/13/25	38	WELLS(100%)	20.0	1.0	3.8	0.3	50.0	2.2	100.0	1.6	22.0	0.6	11.0	0.2	220.0	8.3	340.0	66.0	2.5	0.3	360.0	2.3
	10/02/25	80	FKC (56%)/WELLS(44%)	23.0	1.2	6.6	0.5	59.0	2.5	97.0	1.6	42.0	1.2	11.0	0.2	240.0	7.6	420.0	85.0	2.6	0.2	400.0	3.6
	09/11/25	86	FKC (34%)/CVC (23%)/WELLS(44%)	21.0	1.1	5.7	0.5	45.0	1.9	92.0	1.5	30.0	0.8	6.5	0.1	240.0	8.4	340.0	75.0	8.1	0.3	320.0	3.5
	08/05/25	40	FKC (38%)/CVC (31%)/WELLS(31%)	24.0	1.2	6.1	0.5	47.0	2.0	95.0	1.6	28.0	0.8	6.5	0.1	230.0	7.2	360.0	85.0	4.6	0.3	330.0	3.3
	07/09/25	40	FKC (44%)/CVC (29%)/WELLS(27%)	24.0	1.2	7.9	0.6	52.0	2.2	87.0	1.4	39.0	1.1	6.9	0.1	240.0	8.4	410.0	92.0	4.1	N/A	340.0	5.1
	06/17/25	106	FKC (30%)/CVC (30%)/WELLS(40%)	33.0	1.7	9.8	0.8	48.0	2.1	100.0	1.6	37.0	1.0	11.0	0.2	290.0	8.3	470.0	120.0	0.7	0.2	330.0	4.9
	05/01/25	82	FKC (46%)/WELLS(54%)	29.0	1.5	8.4	0.7	52.0	2.2	97.0	1.6	41.0	1.2	7.8	0.1	270.0	8.4	460.0	110.0	1.9	0.3	390.0	6.3
	04/10/25	148	FKC (98%)/WELLS(2%)	6.4	0.3	1.0	0.1	5.8	0.3	26.0	0.4	3.4	0.1	ND	ND	32.0	7.2	71.0	20.0	4.4	0.1	ND	13.9
	03/04/25	28	WELLS(100%)	19.0	1.0	4.0	0.3	39.0	1.7	87.0	1.4	20.0	0.6	7.9	0.1	260.0	8.4	320.0	64.0	7.1	0.3	210.0	3.7
	02/11/25	8	CVC (100%)	44.0	2.2	10.0	0.8	73.0	3.1	120.0	2.0	43.0	1.2	27.0	0.4	360.0	8.3	620.0	150.0	ND	0.3	560.0	10.8
	01/07/25	58	WELLS(100%)	18.0	0.9	3.5	0.3	27.0	1.2	120.0	2.0	13.0	0.4	5.8	0.1	120.0	7.5	240.0	59.0	5.3	0.2	120.0	3.7
12/11/24	0	DOWN FOR MAINTENANCE	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Average				22.9	1.1	5.7	0.5	43.7	1.9	90.2	1.5	27.5	0.8	10.3	0.2	220.5	8.0	355.2	80.2	3.7	0.2	365.5	7.4
South Canal	01/06/26	10	FKC (100%)	6.2	0.3	0.8	0.1	3.0	0.1	27.0	0.4	1.5	0.0	ND	ND	41.0	7.1	53.0	19.0	0.2	0.0	ND	43.0
	12/08/25	0	DOWN FOR MAINTENANCE/RESIDUAL	19.0	1.0	3.5	0.3	39.0	1.7	95.0	1.6	18.0	0.5	4.4	0.1	180.0	7.8	310.0	63.0	2.0	0.3	270.0	9.8
	11/13/25	6	WELLS(100%)	18.0	0.9	3.6	0.3	51.0	2.2	84.0	1.4	23.0	0.6	13.0	0.2	230.0	8.8	340.0	59.0	2.5	0.3	340.0	7.3
	10/02/25	50	FKC (54%)/WELLS(46%)	27.0	1.4	7.5	0.6	50.0	2.2	93.0	1.5	36.0	1.0	6.7	0.1	220.0	8.0	390.0	97.0	2.1	0.3	290.0	2.2
	09/11/25	20	FKC (32%)/CVC (22%)/WELLS(46%)	23.0	1.2	6.6	0.5	42.0	1.8	98.0	1.6	30.0	0.8	5.9	0.1	230.0	7.6	340.0	85.0	4.4	0.3	250.0	2.4
	08/05/25	24	FKC (37%)/CVC (30%)/WELLS(33%)	26.0	1.3	8.3	0.7	45.0	1.9	100.0	1.6	36.0	1.0	5.8	0.1	250.0	8.3	400.0	99.0	2.9	0.2	210.0	2.9
	07/09/25	134	FKC (42%)/CVC (29%)/WELLS(29%)	25.0	1.3	8.0	0.7	45.0	1.9	100.0	1.6	33.0	0.9	5.9	0.1	220.0	8.3	380.0	96.0	3.2	N/A	250.0	3.3
	06/17/25	274	FKC (27.7%)/CVC (27.7%)/WELLS(44.6%)	29.0	1.5	7.3	0.6	51.0	2.2	110.0	1.8	33.0	0.9	7.4	0.1	270.0	8.1	440.0	100.0	1.8	0.3	380.0	3.1
	05/01/25	70	FKC (42%)/WELLS(58%)	26.0	1.3	7.2	0.6	49.0	2.1	96.0	1.6	33.0	0.9	13.0	0.2	240.0	8.2	420.0	95.0	3.4	0.3	400.0	2.8
	04/10/25	130	FKC (98%)/WELLS(2%)	7.0	0.4	1.1	0.1	5.9	0.3	27.0	0.4	3.4	0.1	ND	ND	32.0	7.0	75.0	22.0	4.3	0.1	ND	15.9
	03/04/25	16	WELLS(100%)	20.0	1.0	5.0	0.4	44.0	1.9	88.0	1.4	25.0	0.7	6.4	0.1	180.0	8.7	350.0	71.0	6.1	0.3	290.0	7.5
	02/11/25	0	CVC (100%)	34.0	1.7	6.8	0.6	74.0	3.2	110.0	1.8	38.0	1.1	14.0	0.2	320.0	8.0	540.0	110.0	ND	0.4	630.0	6.1
	01/07/25	0	SPILLWAY(AQUEDUCT-100%)	16.0	0.8	3.8	0.3	27.0	1.2	110.0	1.8	13.0	0.4	4.1	0.1	140.0	8.0	240.0	56.0	6.2	0.2	140.0	9.5
12/11/24	0	DOWN FOR MAINTENANCE	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Average				21.2	1.1	5.3	0.4	40.5	1.7	87.5	1.4	24.8	0.7	7.9	0.1	196.4	8.0	329.1	74.8	3.3	0.2	313.6	8.9

EXHIBIT "C1"
ARVIN-EDISON WATER STORAGE DISTRICT
WATER SUPPLY WATER QUALITY SUMMARY

	Date	Flow cfs	Import Source	Calcium		Magnesium		Sodium		Bicarbonate		Chloride		Nitrate		TDS mg/l	pH	EC umhos/cm	Hardness mg/l	SAR	Gypsum lbs/AF	Boron mg/l	Turbidity NTU	
				mg/l	me/l	mg/l	me/l	mg/l	me/l	mg/l	me/l	mg/l	me/l	mg/l	me/l									
Interte Pipeline	01/06/26	0	FKC (100%)	26.0	1.3	11.0	0.9	63.0	2.7	91	1.5	84.0	2.4	ND	ND	290	7.9	530	110	2.4	0.3	140.00	6.4	
	12/08/25	0	DOWN FOR MAINTENANCE/RESIDUAL	21.0	1.1	12.0	1.0	66.0	2.8	75	1.2	92.0	2.6	ND	ND	290	7.9	550	100	2.6	0.3	120.00	5.7	
	11/13/25	50	WELLS(50%)/AQUEDUCT(50%)	17.0	0.9	12.0	1.0	66.0	2.8	67	1.1	110.0	3.1	1.5	0.0	300	7.9	520	94	2.6	0.3	100.00	1.6	
	10/02/25	35	FKC (47%)/WELLS(40%)/AQUEDUCT(13%)	18.0	0.9	9.1	0.7	47.0	2.0	67	1.1	58.0	1.6	ND	ND	210	9.1	390	83	1.9	0.2	160.00	16.0	
	09/11/25	100	FKC (23%)/CVC (15%)/WELLS(32%)/AQUEDUCT(25%)/SPILLWAY(5%)	14.0	0.7	9.1	0.7	32.0	1.4	70	1.1	47.0	1.3	ND	ND	170	7.6	280	72	6.1	0.2	ND	4.0	
	08/05/25	123	FKC (31%)/CVC (25%)/WELLS(28%)/AQUEDUCT(8%)/SPILLWAY (8%)	13.0	0.7	7.6	0.6	25.0	1.1	60	1.0	31.0	0.9	ND	ND	160	7.5	250	63	6.3	0.1	ND	5.5	
	07/09/25	63	FKC (36%)/CVC (24%)/WELLS(25%)/AQUEDUCT(15%)	20.0	1.0	11.0	0.9	43.0	1.9	70	1.1	56.0	1.6	1.0	0.0	230	8.1	400	N/A	4.2	N/A	130.00	8.0	
	06/17/25	40	FKC (27.7%)/CVC (27.7%)/WELLS(44.6%)	25.0	1.3	8.5	0.7	49.0	2.1	88	1.4	36.0	1.0	5.0	0.1	250	8.6	410	97	3.1	0.2	360.00	4.0	
	05/01/25	40	FKC (36%)/WELLS(49%)/SPILLWAY(14%)	22.0	1.1	5.4	0.4	42.0	1.8	83.0	1.4	25.0	0.7	5.7	0.1	220.0	8.6	350.0	77.0	5.2	0.3	370.0	6.3	
	04/10/25	0	FKC (98%)/WELLS(2%)	8.7	0.4	1.2	0.1	6.3	0.3	31.0	0.5	3.6	0.1	ND	ND	61.0	7.3	84.0	27.0	4.0	0.1	ND	12.4	
	03/04/25	0	WELLS(100%)	24.0	1.2	7.3	0.6	41.0	1.8	87.0	1.4	29.0	0.8	5.1	0.1	280.0	8.6	370.0	90.0	3.9	0.2	210.0	13.2	
	02/11/25	0	CVC (54%)/SPILLWAY (46%)	19.0	1.0	6.2	0.5	45.0	1.9	74.0	1.2	35.0	1.0	3.3	0.1	200.0	8.8	340.0	73.0	6.5	0.2	270.0	13.5	
	01/07/25	0	SPILLWAY(AQUEDUCT-100%)	19.0	1.0	12.0	1.0	55.0	2.4	93.0	1.5	83.0	2.3	2.0	0.0	230.0	7.8	480.0	97.0	3.1	0.2	120.0	6.0	
	12/11/24	0	DOWN FOR MAINTENANCE	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Average			19.0	0.9	8.6	0.7	44.6	1.9	73.5	1.2	53.0	1.5	3.4	0.1	222.4	8.1	381.1	81.9	4.0	0.2	198.0	7.9

Water Supply Water Quality Note: ¹ Positive flow rate is reverse flow into the District. Where the reported value is ND, the method detection limit is entered.

Water Supply Water Quality Note: ² Reverse flow into the District South Canal (Sycamore check gate was closed).

Water Supply Water Quality Note: ³ Constituent ran past sample hold time.

ND: NONE DETECTED.

N/A: NOT AVAILABLE OR NOT TESTED.

PR: PENDING RESULTS

mg/l: MILLIGRAMS PER LITER; SAME AS PARTS PER MILLION (ppm).

me/l: MILLEQUIVALENTS PER LITER; SAME AS EQUIVALENTS PER

INTAKE: SAMPLE TAKEN AT COTTONWOOD RD. SOUTH OF PANAMA LANE.

NORTH: SAMPLE TAKEN DOWNSTREAM OF SYCAMORE CHECK GATE.

SOUTH: SAMPLE TAKEN DOWNSTREAM OF TEJON CHECK GATE.

INTERTIE: TERMINUS OF SOUTH CANAL (S93 FOREBAY).

SODIUM: FOR SURFACE IRRIGATION: SAR < 3 IS GOOD. FOR SPRINKLER IRRIGATION: SODIUM < 3 me/l IS GOOD.

NITRATE: NITRATE IN WATER SLIGHTLY REDUCES FERTILIZER REQUIREMENT.

BICARBONATE: BICARBONATE < 1.5 me/l IS SATISFACTORY FOR OVERHEAD SPRINKLERS.

CHLORIDE: FOR SURFACE IRRIGATION CHLORIDE < 4 me/l IS GOOD.

TDS: TDS < 450 IS ACCEPTABLE FOR UNRESTRICTED USE.

GYPSUM: AMOUNT OF CALCIUM SULFATE IN POUNDS PER ACRE-FOOT OF WATER APPLIED. INCREASES WATER PERMEABILITY AND HELPS CORRECT EXCESS SODIUM. INCREASES CLAY FLOCCULATION FOR INCREASING PERMEABILITY.

pH: A MEASURE OF ACIDITY. A pH < 7 IS ACIDIC, pH = 7 IS NEUTRAL, pH > 7 IS BASIC. NORMAL RANGE IS 6.5 - 8.4. A pH > 8 MAY NEED TO BE BUFFERED FOR PESTICIDE APPLICATION. AFFECTS NUTRIENT AVAILABILITY.

EC: ELECTRICAL CONDUCTIVITY. A MEASURE OF WATER SALINITY; SOIL - IN MILLIMHOS PER CENTIMETER (mmho/cm); WATER - MORE OFTEN, IN MICROMHOS PER CENTIMETER (umhos/cm). EC < 700 (umhos/cm) HAS NO RESTRICTIONS FOR AGRICULTURAL USE. EC < 200 (umhos/cm) CAN REDUCE INFILTRATION RATE.

HARDNESS: HARD WATER, INDICATING CALCIUM AND MAGNESIUM, IS BENEFICIAL FOR AGRICULTURE.

SAR: SODIUM ADSORPTION RATIO. A RATIO OF SODIUM TO CALCIUM AND MAGNESIUM.


EVALUATE WITH EC.

SAR = 0 - 3 AND EC > 400 ACCEPTABLE

SAR = 3 - 6 AND EC > 900 ACCEPTABLE

BORON: BORON < 0.50 mg/l IS SATISFACTORY FOR ALL CROPS. EXCESSIVE BORON IS PHYTOTOXIC (BURNS) TO PLANTS.

EXHIBIT "D"
ARVIN-EDISON WATER STORAGE DISTRICT
SUMMARY OF CLIMATOLOGICAL OBSERVATIONS

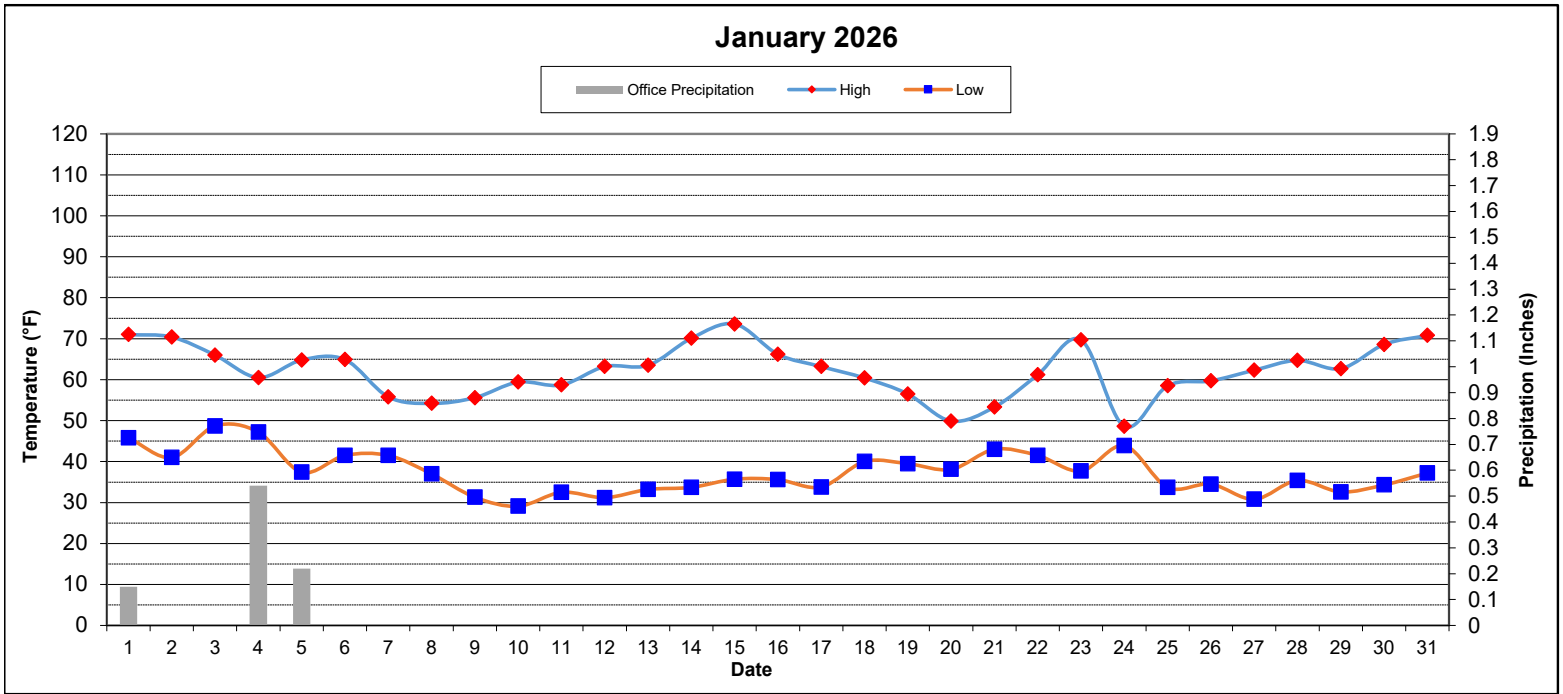

PRECIPITATION	BAL RES (1)		OFFICE (2)		SYCAMORE (3)		TEJON (4)		INTERTIE (5)	
	INCHES	% AVG.	INCHES	% AVG.	INCHES	% AVG.	INCHES	% AVG.	INCHES	% AVG.
AVG. MONTHLY	0.91		1.40		1.32		1.14		0.94	
AVG. YEAR TO DATE	4.02		4.27		4.18		3.65		3.97	
CURRENT MONTH	0.99	109%	0.91	65%	0.87	66%	0.82	72%	0.93	99%
CUMULATIVE (07/01/25 - 06/30/26)	7.25	180%	7.52	176%	7.18	172%	6.38	175%	6.45	162%

TEMPERATURE (6)	(°F)	DATE	TIME
MAXIMUM TEMPERATURE	74	1/15/2026	4:00 PM
AVERAGE MAXIMUM TEMPERATURE	62		
# DAYS THIS MONTH ABOVE 100 °F	0		
MINIMUM TEMPERATURE	29	1/10/2026	4:00 AM
AVERAGE MINIMUM TEMPERATURE	37		
# DAYS THIS MONTH BELOW 32 °F	0		

WIND (6)	M.P.H.	DATE	TIME	DRCTN
MAXIMUM WIND SPEED	4.4	1/8/2026	6:30 PM	NE
AVERAGE WIND SPEED	2.9			
AVERAGE WIND SPEED @ 8:00 AM	2.7			

BAROMETRIC PRESSURE (7)	IN. HG	DATE	TIME
AVERAGE PRESSURE @ 8:00 AM	29.63		
MAXIMUM PRESSURE	30.00	1/10/2026	9:00 AM
MINIMUM PRESSURE	29.30	1/23/2026	8:00 PM

NOTES

(1) October 2018 to Present data gathered from District rain gauges
(2) 1975 to Present data gathered from District rain gauges
(3) 1968 to Present data gathered from District rain gauges
(4) 1967 to Present data gathered from District rain gauges
(5) October 2018 to Present data gathered from District rain gauges
(6) Data retrieved from CIMIS (<http://www.cimis.water.ca.gov/WSNReportCriteria.aspx>) (125 Arvin-Edison)
(7) Data retrieved from Weather Underground (<https://www.wunderground.com/us/ca/arvin/zmw:93203.1.99999>)
Precipitation Day is 8:00 AM to 8:00 AM

EXHIBIT "E"

ARVIN-EDISON WATER STORAGE DISTRICT

WY2025 ENERGY CONSUMPTION AND POWER DEMAND

ENERGY CONSUMED - KWH							TOTAL DEMAND - KW						
Month	Forrest Frick PP	Distrib. System	Spreading	Wells	Intertie PP	Total	Forrest Frick PP	Distrib. System	Spreading	Wells	Intertie PP	Total	Load Factor
MAR 25	98,158	1,181,591	1,339	3,002,380	3,235	4,286,703	1,214	11,390	89	12,647	5	25,345	23%
APR	1,574,485	3,476,794	20,963	3,569,188	3,310	8,644,741	5,390	14,147	1,734	7,998	5	29,275	41%
MAY	2,132,302	5,523,953	23,656	6,556,012	3,253	14,239,176	4,962	15,442	366	9,458	5	30,234	63%
JUN	2,300,912	6,122,900	40,162	7,539,646	3,077	16,006,697	5,392	15,424	354	11,589	5	32,763	68%
JUL	2,543,456	6,559,900	7,680	4,944,401	4,076	14,059,513	5,361	15,495	350	7,152	8	28,367	67%
AUG	2,090,354	6,189,943	5,294	5,281,616	4,677	13,571,883	4,998	15,299	259	7,711	9	28,275	65%
SEP	1,402,738	4,981,110	9,915	4,996,466	4,249	11,394,478	3,792	15,362	354	7,590	9	27,106	58%
OCT	436,284	2,616,418	11,431	4,073,885	3,910	7,141,928	2,644	14,019	268	7,635	8	24,574	39%
NOV	144,586	843,728	1,345	1,036,524	3,655	2,029,837	1,181	10,683	4	6,746	11	18,625	15%
DEC	378,933	149,397	33,993	76,925	3,249	642,497	1,916	5,346	84	607	5	7,959	11%
JAN 26	6,542,533	1,147,229	575,634	29,939	308,758	8,604,093	12,059	6,496	1,786	193	755	21,288	54%
FEB													
TOTAL	19,644,741	38,792,962	731,410	41,106,982	345,449	100,621,544							

Notes: - Since 2005 KW records reflect non-simultaneous demands.
 - Energy use for lighting accounts for approximately 90,000 kWh/month at District wellfields and 4,000 kWh/month at the Intertie Pumping Plant

2/6/2026

EXHIBIT "F"
 ARVIN-EDISON WATER STORAGE DISTRICT
 2025 WATER YEAR WELLFIELD PRODUCTION - AF

Month	Bal Res		North Canal 5		Wellfield						Total		
	AF	% of Historical Max	AF	% of Historical Max	North		Sycamore		Tejon		AF	AF / Day	% of Historical Max
					AF	% of Historical Max	AF	% of Historical Max	AF	% of Historical Max			
MAR - 25	0	0%	384	32%	1,261	49%	1,431	22%	668	12%	3,744	121	24%
APR	0	0%	484	40%	1,339	44%	2,076	30%	548	11%	4,447	148	30%
MAY	0	0%	869	70%	2,328	63%	3,839	53%	1,092	20%	8,128	262	54%
JUN	0	0%	812	40%	2,885	78%	3,629	181%	1,692	85%	9,018	291	60%
JUL	0	0%	690	55%	2,696	71%	2,155	29%	523	10%	6,064	196	37%
AUG	0	0%	669	54%	2,555	68%	2,590	35%	596	12%	6,410	207	40%
SEP	0	0%	638	52%	2,535	77%	2,384	36%	539	12%	6,096	203	43%
OCT	0	0%	576	46%	2,002	60%	2,018	30%	370	8%	4,966	160	34%
NOV	0	0%	170	15%	491	24%	525	10%	0	0%	1,186	40	10%
DEC	0	0%	0	0%	0	0%	0	0%	0	0%	0	0	0%
JAN - 26	0	0%	0	0%	0	0%	0	0%	0	0%	0	0	0%
FEB		0%		0%		0%		0%		0%	0	0	0%
Total	0		5,292		18,092		20,647		6,028		50,059	136	28%
Ratio	0%		11%		36%		41%		12%		100%	Average	
Wells	4		5		14		34		29		86		

EXHIBIT "H-1"
ARVIN-EDISON WATER STORAGE DISTRICT
STATIC VS PUMPING WATER LEVELS IN DISTRICT WELLS - JAN 2026
 ALL VALUES IN FEET

	WELL #	STATIC LEVEL	PUMPING LEVEL	BOWL ¹ DEPTH	TOTAL DEPTH	DRAW ^{2,3} DOWN	BOWL ⁴ COVERAGE
NORTH CANAL (23)	N1	465	572	610	840	107	38
	N2	446	575	700	840	129	125
	N3	381	409	610	840	28	201
	N4	439	465	550	864	25	85
	N5	451	463	650	864	12	187
	N6	437	480	640	920	43	160
	N7	436	464	600	1010	28	136
	N8	382	431	560	970	49	129
	N9	439	552	700	990	113	148
	N10	430	490	560	990	60	70
	N11	384	428	562	1020	44	134
	N12	431	461	600	1030	30	139
	N13	436	468	600	1000	32	132
	N14	436	459	540	900	23	81
	N15	374	520	700	1200	146	180
	N16	396	510	600	1200	114	90
	N17	N/A	N/A	610	1200	N/A	N/A
	N18	346	406	610	1190	60	204
	N19	446	487	760	1300	42	273
	N20	404	469	820	1020	65	351
	N21	428	518	660	950	90	142
	N22	422	446	680	990	24	234
	N23	413	433	680	990	20	247
Avg	419	478					

	WELL #	STATIC LEVEL	PUMPING LEVEL	BOWL ¹ DEPTH	TOTAL DEPTH	DRAW ^{2,3} DOWN	BOWL ⁴ COVERAGE
TEJON (28)	71	451	484	800	1050	32	316
	72	444	460	800	1045	16	340
	73	451	486	800	1018	35	314
	74	437	488	800	1084	51	312
	75	440	458	800	1045	18	342
	76	432	483	700	996	51	217
	77	440	518	800	1066	79	282
	78	440	497	800	1038	58	303
	79	414	524	700	1032	111	176
	80	419	511	800	996	92	289
	81	319	423	700	925	104	277
	82	430	481	800	996	51	319
	83	407	N/A	N/A	N/A	N/A	N/A
	84	N/A	N/A	700	955	N/A	N/A
	86	463	495	800	996	32	305
	87	458	488	800	984	30	312
	88	458	488	800	948	30	312
	89	437	472	800	996	35	328
	90	515	550	700	996	35	150
	92	490	541	800	996	51	259
	93	451	469	800	996	18	331
	94	537	636	860	996	99	224
	95	474	N/A	N/A	N/A	N/A	N/A
	96	456	599	800	996	143	201
	98	N/A	N/A	760	1340	N/A	N/A
	99	440	479	760	1340	39	281
	100	395	432	760	1340	37	328
	101	423	484	760	1310	61	276
	Avg	443	498				

OUT OF SERVICE (3)
AIRLINE FAILURE, ACCOUSTIC SOUNDER USED (15)
MONITORING WELLS (4)
UNSTABLE DATA (1)

	WELL #	STATIC LEVEL	PUMPING LEVEL	BOWL ¹ DEPTH	TOTAL DEPTH	DRAW ^{2,3} DOWN	BOWL ⁴ COVERAGE
SYCAMORE (34)	1	398	435	705	800	37	270
	2	309	443	690	876	134	247
	4	427	464	700	876	37	236
	5	438	445	720	876	7	275
	6	367	422	690	876	55	268
	7	409	457	700	830	49	243
	8	418	N/A	N/A	N/A	N/A	N/A
	9	427	474	700	886	46	226
	10	401	415	690	850	14	275
	11	402	444	700	880	42	256
	12	430	469	700	860	39	231
	13	N/A	N/A	700	850	N/A	N/A
	14	356	402	670	810	46	268
	15	426	516	710	820	90	194
	16	427	508	700	888	81	192
	17	380	583	650	820	203	67
	18	401	424	650	820	23	226
	20	387	424	680	804	37	256
	21	385	443	690	856	58	247
	22	381	409	610	792	28	201
	23	378	404	600	788	25	196
	24	388	421	580	780	32	159
	25	384	409	610	777	25	201
	26	378	438	690	816	60	252
	28	360	420	660	782	60	240
	29	397	438	690	787	42	252
	31	408	468	660	725	60	192
	32	N/A	N/A	640	739	N/A	N/A
	33	416	529	700	780	113	171
	34	418	N/A	N/A	N/A	N/A	N/A
	35	414	494	700	800	81	206
	36	407	444	600	820	37	156
	37	402	434	540	820	32	106
	38	418	474	860	1270	56	383
Avg	397	452					

MONTHLY SUMMARY - AVERAGE WATER LEVELS						
READINGS	STATIC LEVELS			PUMPING LEVELS		
	N. CANAL	SYCAMORE	TEJON	N. CANAL	SYCAMORE	TEJON
JAN-25	428	390	439	482	440	497
FEB	433	398	440	486	449	499
MAR	425	392	452	484	449	507
APR	429	418	459	488	474	512
MAY	430	428	473	489	484	526
JUN	436	423	489	495	480	545
JUL	435	420	489	495	476	544
AUG	436	423	487	496	478	541
SEP	436	421	483	494	477	537
OCT	429	413	469	487	468	524
NOV	423	403	458	481	458	512
DEC	421	399	449	479	454	504
JAN-26	419	397	443	478	452	498
12 MONTH CHANGE	+09	-07	-04	+04	-12	-01

¹ Bowl depth is measured from the bottom of the bowls to top of the pump.
² When pumps aren't running, pumping levels are estimated based on previous draw down records. (6 month avg.)
³ Red numbers indicate drawdowns that are above 100.
⁴ Red numbers indicate bowl coverage that is below 50.

